Smart Temp™ Australia

RS-1/02
Indoor Sensor

Optional

UI1 0V

Sw1 1-OFF
2-OFF
3-ON
4-OFF

Halo SMT-850 Thermostat


24C 24 R Y1 W1 G1

24- 24+ Y1 W1 G

Setting for Daikin Control Card
TB_THM-1
Sw1 - ON
Sw2 to 8 Off


Daikin UAYQ - Single Stage

Halo Terminals

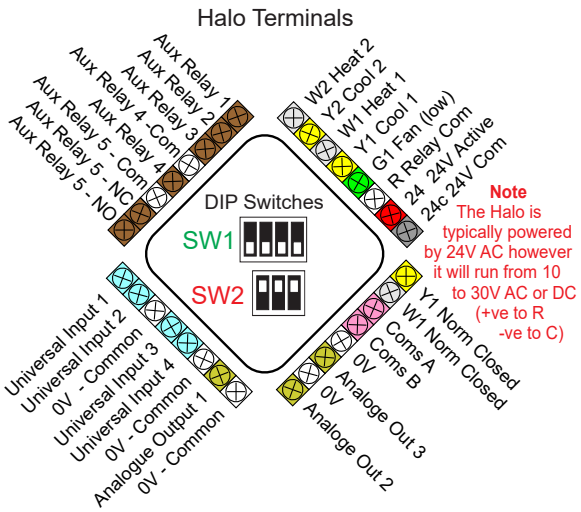

Note
The Halo is typically powered by 24V AC however it will run from 10 to 30V AC or DC (+ve to R -ve to C)

Halo Installer settings

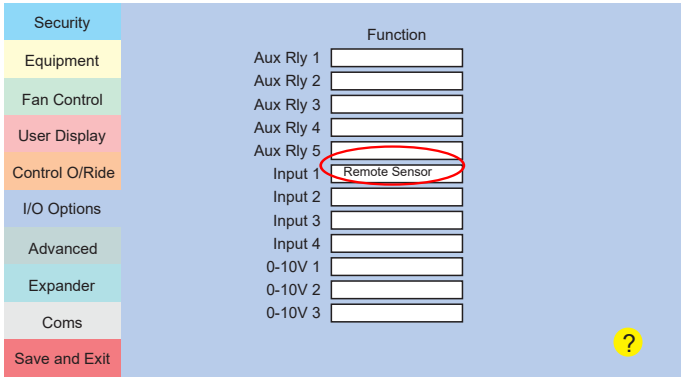

Optional Sensor Settings

Installer Menu I/O Options and Equipment Settings - Default Pin is 0021

Smart Temp™ Australia

Installation Drawing

Drawing Revision History		
10-11-2026	REV 1.0	By: John K

Drawing Name

Smart Temp Halo SMT-850 wired to a Daikin UAYQ Single stage

All care has been taken in the preparation of this drawing however Smart Temp Australia accept no responsibility for damage that may be caused by using this information. This is a guide only.

Unit 20, 1488 Ferntree Gully Road Knoxfield Vic 3180 Ph:(03) 9763 0094 www.thermostat.com.au