



Note- Set Viking analogue output settings for Y1 to H&C

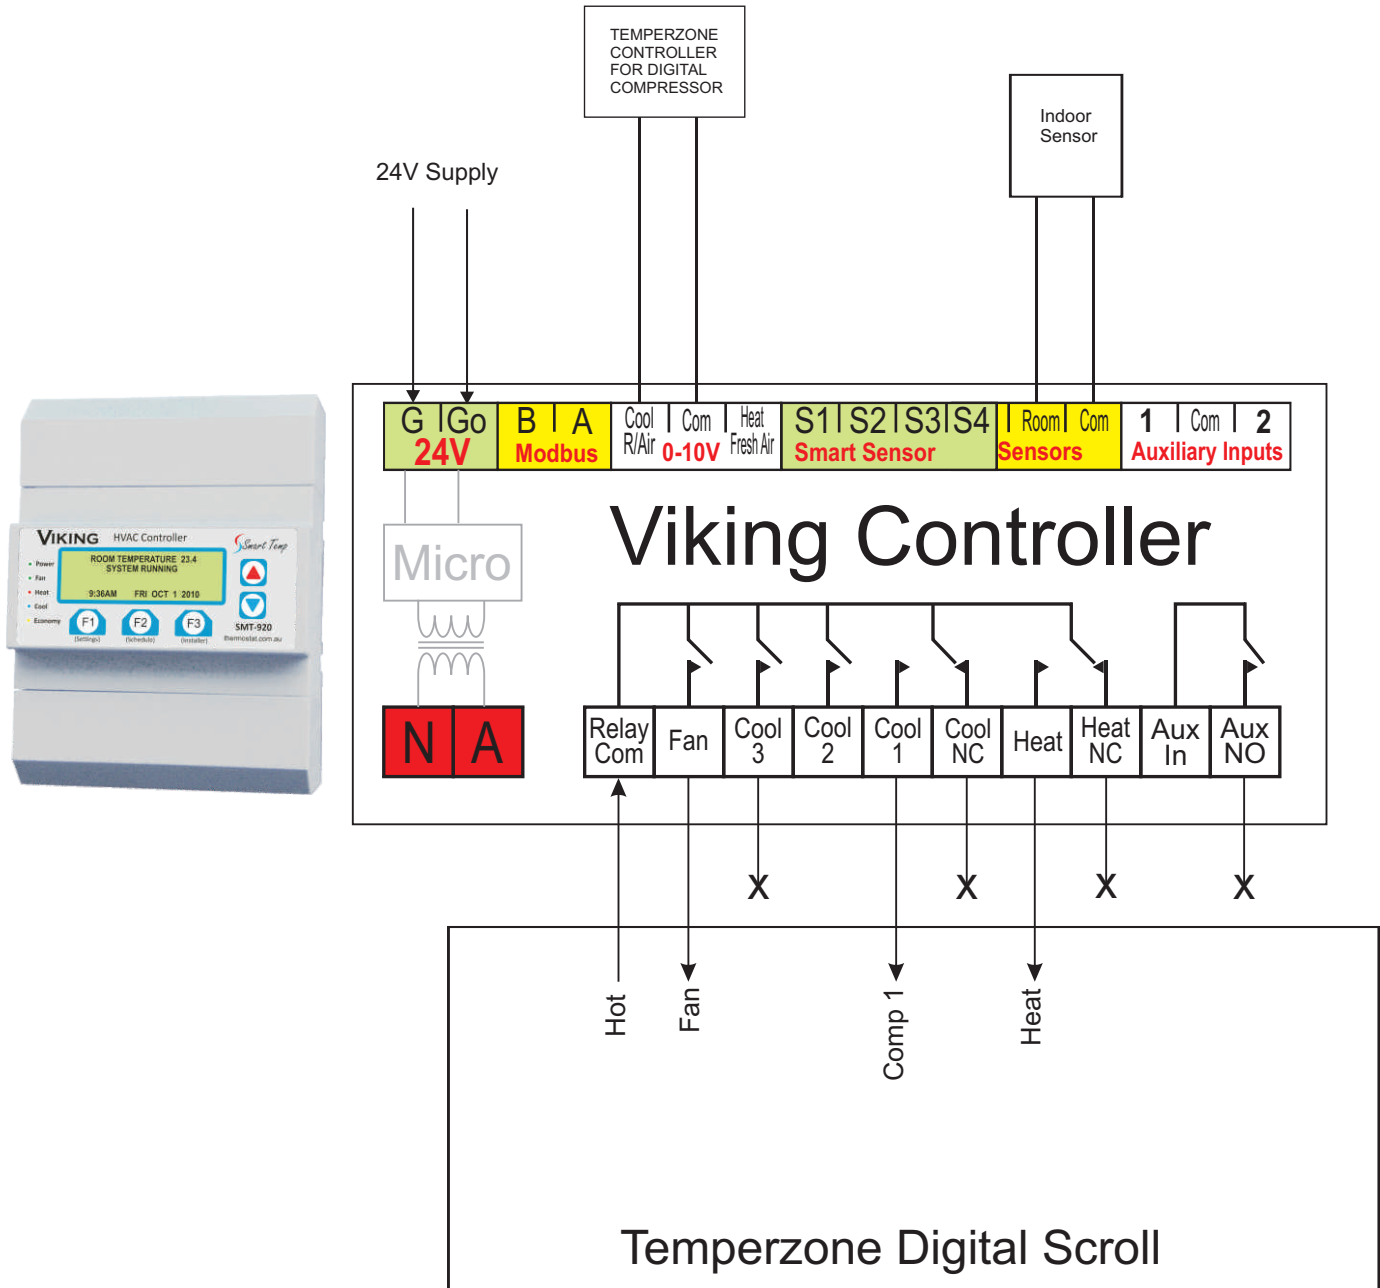

		<h3>Installation Drawing</h3>	
<b>Drawing Revision History</b>		<b>Drawing Name</b> Temperzone Digital Scroll interfaced to a Smart Temp Viking	
10-12-2013	REV 1.0	By: John K	
Unit 20, 1488 Ferntree Gully Road Knoxfield Vic 3180		Ph: (03) 9593 0004 Fax: (03) 9593 0088 <a href="http://www.thermostat.com.au">www.thermostat.com.au</a>	

ALL CARE AND DILIGENCE HAS BEEN TAKEN IN THE PREPARATION OF THIS INTERFACE DIAGRAM. **SMART TEMP AUSTRALIA PTY LTD** WILL ONLY BE RESPONSIBLE FOR DAMAGE CAUSED TO THE SMART TEMP PRODUCT, AND ONLY IF IT HAD BEEN CORRECTLY APPLIED IN ACCORDANCE WITH THE MANUFACTURES INSTRUCTIONS. IT IS THE DEALER / CONTRACTORS SOLE RESPONSIBILITY TO ENSURE CORRECT OPERATION OF THE MAJOR EQUIPMENT IS MAINTAINED.