


Belimo LMU-24 Actuator  
Set to Position 0

Smart Temp DM-24.04 Actuator  
Set to CCW

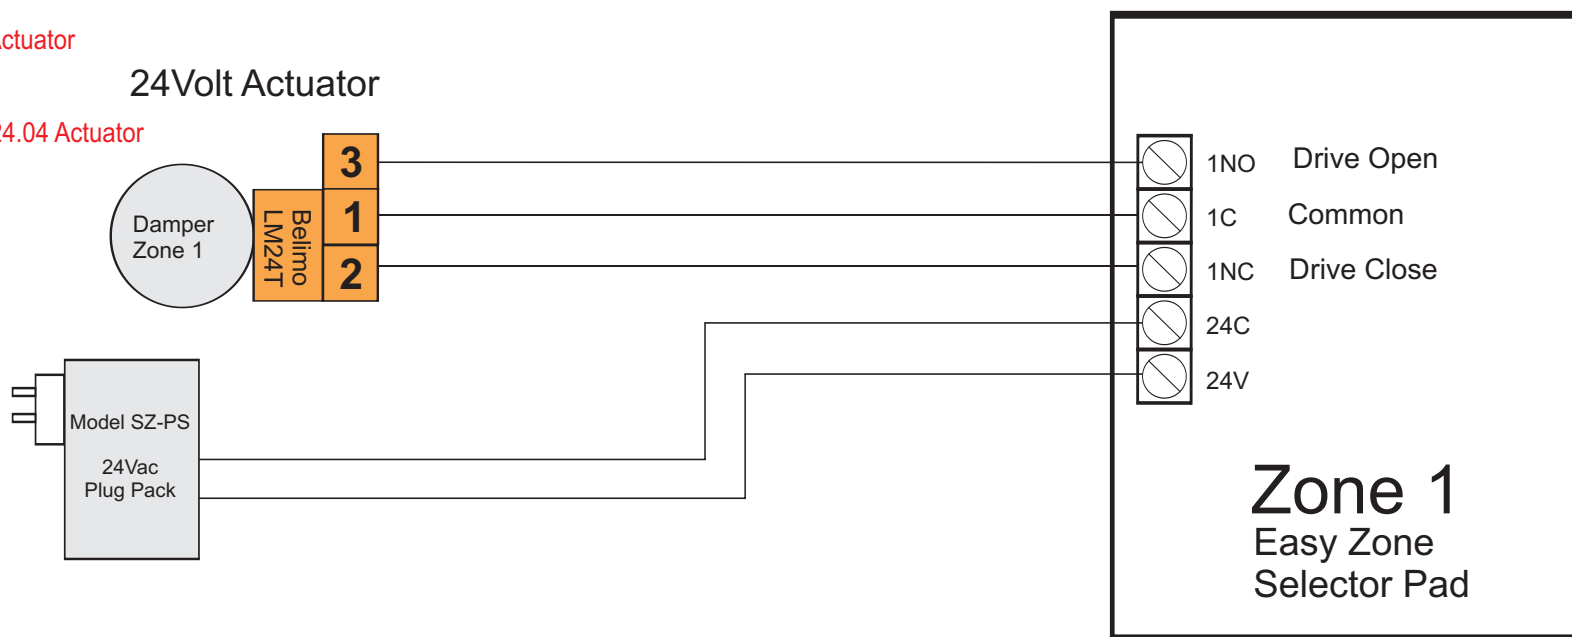


## CAUTION

### Wiring multiple zones in parallel

Some actuators are not suitable for wiring in parallel due to feedback from actuator. Please check with your damper manufacturer to ensure your actuators are suitable for parallel connection.



		<b>Installation Drawing</b>	
Drawing Revision History			Drawing Name
			<b>Easy Zone 1 Selector Pad with 24V Belimo Actuator</b>
			<small>All care has been taken in the preparation of this drawing however Smart Temp Australia accept no responsibility for damage that may be caused by using this information. This is a guide only.</small>
29-09-2008	REV B	By: JK	
<b>Smart Temp</b>			Ph: (03) 9763 0094 Fax: (03) 9763 0098 www.smart-temp.com.au